

RS 1000÷1200/M C01 SERIES


The well-known RS 300-800/M Burner Series, till now available up to 8 MW, has been upgraded with two new powerful burner models, the RS 1000-1200/M models that extend his max output up to 12 MW and make the Burner Series even more complete and suitable for matching with the various Heat and Steam Generators in today's market. The New Burner Models take the reliability of combustion and the solidity typical of Riello's Burners and match them with the most advanced solutions on Power Output Control and Ventilation Technology; as result a 12 MW output is supplied with a User Friendly monoblock machine assuring easiness of installation and servicing, and safe operation. An easy access to internal components is ensured by the burner opening hinge.

The New Gas Models are available with Modulating operation managed through Mechanical Cam, for a simple commissioning and to supply with precision the demanded power, guaranteeing high efficiency and setting stability, obtaining fuel consumption and operating costs reduction.



RS 1000/M C01	1100/4000 ÷ 10100 kW
RS 1200/M C01	1500/5500 ÷ 11100 kW

FIRING RATES

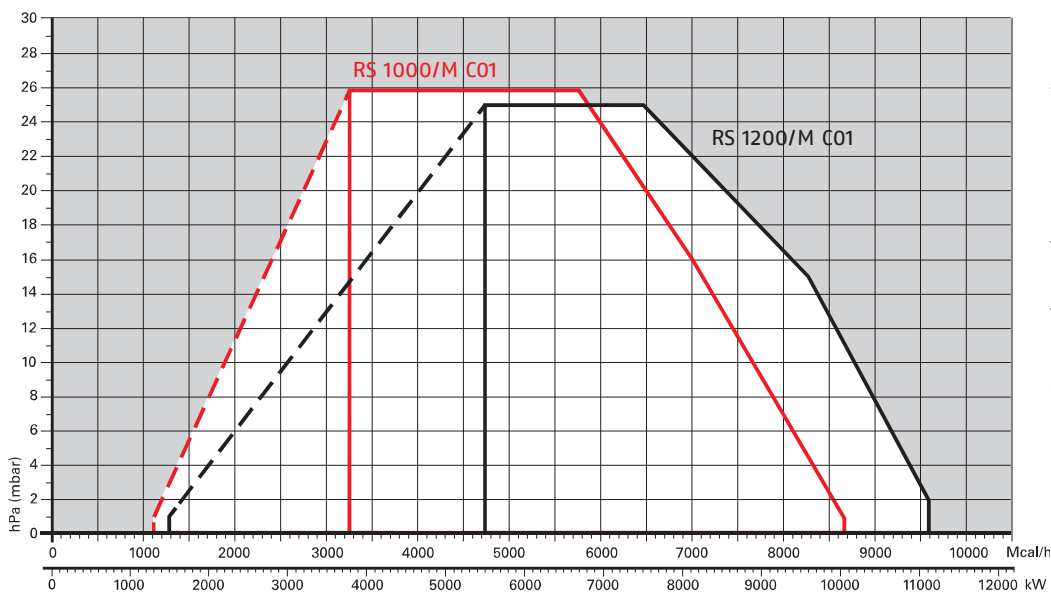

□ Useful working field for choosing the burner

□ Modulation range


Test conditions conforming to EN676
 Temperature: 20°C
 Pressure: 1013,5 mbar
 Altitude: 0 m a.s.l.

Modulating Gas Burners

RS 1000-1200/M C01 SERIES

Overall dimensions (mm)


BURNER

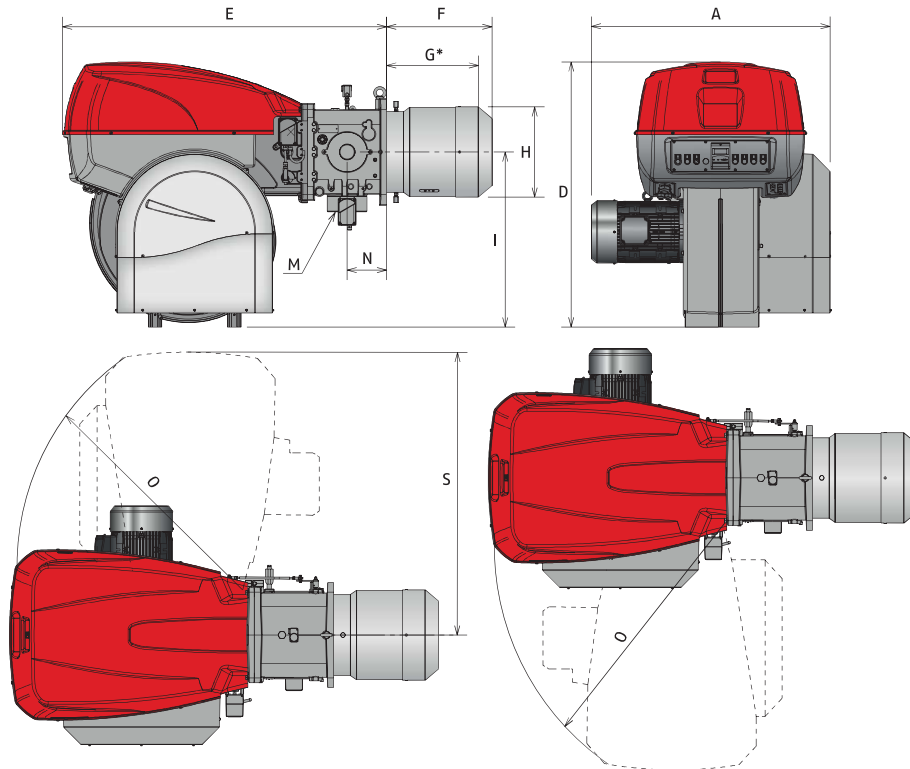

MODEL	A	D	E	F	G*	H	I	M	N	O	S
▶ RS 1000/M C01	1206	1338	1637	538	485	413	885	DN80	200	1350	1493
▶ RS 1200/M C01	1250	1338	1637	539	485	456	885	DN80	200	1350	1493


* Maximum depth of the boiler door including the depth of the burner flange insulating gasket.

BURNER - BOILER MOUNTING FLANGE



MODEL	D1	D2	Ø
▶ RS 1000/M C01	460	608	M20
▶ RS 1200/M C01	500	608	M20

PACKAGING

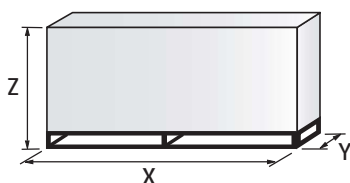

MODEL	X	Y	Z	kg
▶ RS 1000/M C01	2400	1400	1595	500
▶ RS 1200/M C01	2400	1400	1595	550

Modulating Gas Burners

RS 1000÷1200/M C01 SERIES

RIELLO

Specification

DESIGNATION OF SERIES

Series: R									
Fuel: S Natural Gas									
L Light oil									
LS Light oil/Natural Gas									
N Heavy oil									
Size:									
Setting: /1 Single stage									
/B Two stage									
/M Modulating-Mechanical cam									
/E Electronic cam									
/P Proportioning air/gas valve									
/EV Electronic cam predisposed for variable speed (with inverter)									
/EVi Electronic cam with integrated inverter									
Emission: ... or C01									
					Class 1 EN676				
MZ					Class 2 EN676				
BLU					Class 3 EN676				
MX					Class 3 EN676				
Head length: TC standard head									
TL extended head									
Flame control system: FS1 Standard/Intermittent (at least 1 stop every 24 h)									
FS2 Continuous (1 stop every 72 h)									
Electrical supply to the system:									
1/230/50					1/230V/50Hz				
3/230/50					3/230V/50Hz				
3/400/50					3N/400V/50Hz				
3/230-400/50					3/230V/50Hz - 3N/400V/50Hz				
3/220/60					3/220V/60Hz				
3/380/60					3N/380V/60Hz				
3/220-380/60					3/220/60Hz - 3N/380V/60Hz				
Auxiliary voltage: 230/50-60 230V/50-60H									
110/50-60 110V/50-60Hz									
R	S	1000	/M	C01	TC	FS1	3/230-400/50	230/50-60	
BASIC DESIGNATION									
EXTENDED DESIGNATION									

GAS

Specification

STATE OF SUPPLY

Monoblock forced draught gas burner with modulating operation, fully automatic, made up of:

- Fan with reverse curve blades high performance
- Air suction circuit lined with sound-proofing material
- Air damper for air setting controlled by a high precision servomotor
- Air pressure switch
- Fan starting motor at 2900 rpm, three-phase 230/400 - 400/690 V with neutral, 50 Hz
- Low emission combustion head, that can be set on the basis of required output, fitted with:
 - stainless steel end cone, resistant to corrosion and high temperatures
 - ignition by gas pilot with gas train
 - flame stability disk
- Maximum gas pressure switch, with pressure test point, for halting the burner in the case of over pressure on the fuel supply line
- Burner safety control box for controlling the system safety (RFG0 for FS1 intermittent operation - LGK16 for FS2 continuous operation)
- UV photocell for flame detection
- Star/delta starter for the fan motor
- Main electrical supply terminal board
- Burner on/off switch
- Auxiliary voltage led signal
- Manual or automatic output increase/decrease switch
- Burner working led signal
- Contacts motor and thermal relay with release button
- Motor internal thermal protection
- Motor failure led signal
- Burner failure led signal and lighted release button
- Led signal for correct rotation direction of fan motor
- Emergency button
- Coded connection plugs-sockets
- Burner opening hinge
- Lifting rings
- IP 54 electric protection level

Standard equipment:

- 1 flange gasket
- 8 screws for fixing the flange
- 1 thermal screen
- 4 screws for fixing the burner flange to the boiler
- DN 80 gas supply connector for gas train connection
- Instruction handbook for installation, use and maintenance
- Spare parts catalogue.

Available models

Burners

CODE	MODEL					HEAT OUTPUT		TOTAL ELECTRICAL POWER (kW)	NOTE
						NATURAL GAS (kW)	(Nm ³ /h)		
20145938	RS 1000/M C01	TC	FS1/FS2	3/400/50	230/50-60	1100/4000-10100	130/380-940	24	(1)(2)(4)
20145936	RS 1200/M C01	TC	FS1/FS2	3/400/50	230/50-60	1500/5500-11100	150/550-1150	27.2	(1)(2)(4)

Natural gas, net calorific value: 10 kWh/Nm³ - Density: 0,71 kg/Nm³

(1) according to 2014/30/EU - 2014/35/EU - 2006/42/EU - 2014/68/EU Directives

(2) with RFG0 control box

(3) with LFL control box

(4) FS2 operation is allowed with ionization probe only, no other flame sensors can be used

Due to the improvement of the technical specification of some products, some burner codes have been changed. The table below summarizes the correspondence between the previous and the new code.

MODEL				NEW CODE		OLD CODE	
RS 1000/M C01	TC	FS1/FS2	3/400/50	20145938	(2)(4)	20061873	(3)
RS 1200/M C01	TC	FS1/FS2	3/400/50	20145936	(2)(4)	20061850	(3)

Gas Trains

CODE	GAS TRAIN			VPS CODE	ADAPTER CODE	
	MODEL	Ø	C.T.		RS 1000	RS 1200
20137718*	VGD 50/1 - RT 122	Rp 2"	-	3010123+ 20186306	●	●
20169190**	VGD 50/1 CT RT 122	Rp 2"	◆	◆	●	●
20140762*	VGD 65/1 - FT 122	DN 65 (1)	-	3010123	●	●
20169191**	VGD 65/1 CT FT 122	DN 65 (1)	◆	◆	●	●
20140763*	VGD 80/1 - FT 122	DN 80	-	3010123	20066268 / (20065937 + 20066268) (2)	
20169192**	VGD 80/1 CT FT 122	DN 80	◆	◆	20066268 / (20065937 + 20066268) (2)	
20169193*	VGD 100/1 - FT 122	DN 100	-	3010123	20066278 / (20065960 + 20066278) (2)	
20169194**	VGD 100/1 CT FT 122	DN 100	◆	◆	20066278 / (20065960 + 20066278) (2)	
20169195*	VGD 125/1 - FT 122	DN 125	-	3010123	20066284 / (20065968 + 20066284) (2)	
20169196**	VGD 125/1 CT FT 122	DN 125	◆	◆	20066284 / (20065968 + 20066284) (2)	

Please see designation of Gas Train Series in the page before the Catalogue index.

* 230V/50Hz - 220V/60Hz electrical supply.

** 230V/50Hz electrical supply.

The valve seal control device is compulsory (conforming to EN 676) on gas trains to burners with a maximum output over 1200 kW.

To select the gas train please refer to the technical data leaflet and/or instruction manual.

(1) Øin = DN 65, Øout = DN 80.

(2) To be used with gas train and burner opening on the left (fan motor side).

C.T. Gas valve leak detection control device:

- gas train not equipped with leak detection control device; this device can be ordered separately - see VPS column - and installed later.

◆ gas train equipped with leak detection control device.

VPS Valve leak detection control device. Supplied separately from the gas train (please see Gas train accessories paragraph for both 50 Hz and 60 Hz codes).

● Not available.

□ Additional adapter not necessary, the gas train may be connected directly to the burner.

Modulating Gas Burners

RS 1000÷1200/M C01 SERIES

Burner accessories

Accessories for modulating operation

POWER CONTROLLER



To obtain modulating operation, the RS/M C01 series of burners requires a regulator with three point outlet controls. The following table lists the accessories for modulating operation with their application range. For remote setpoint use RWF 55.

BURNER	TYPE	KIT CODE
► All models	RWF 50.2	20101190
	RWF 55.5	20101191

PROBE



The relative temperature or pressure probes fitted to the power controller must be chosen on the basis of the application.

BURNER	TYPE	RANGE (°C) (bar)	KIT CODE
► All models	Temperature PT 100	-100 ÷ 500°C	3010110
	Pressure 4 ÷ 20 mA	0 ÷ 2,5 bar	3010213
	Pressure 4 ÷ 20 mA	0 ÷ 16 bar	3010214
	Pressure 4 ÷ 20 mA	0 ÷ 25 bar	3090873

ANALOG CONTROL SIGNAL CONVERTER



BURNER	TYPE (INPUT SIGNAL)	KIT CODE
► All models	0/2 - 10 V (impedance 200 KΩ)	3010390
	0/4 - 20 mA (impedance 250 Ω)	

POTENTIOMETER



BURNER	KIT CODE
► RS 1000-1200/M C01	On demand

Continuous ventilation kit




If the burner requires continuous ventilation in the stages without flame, a special kit is available as given in the following table:

BURNER	KIT CODE
► All models	20086519

Burner accessories

Sound proofing box



If noise emission needs reducing even further, sound-proofing boxes are available. When a lower "B" dimension is required, it is available the Box Support Kit code 20065135 which allows to reduce it at the fixed dimension of 55 mm. The sound-proofing boxes are not suitable for outdoor use.

BURNER	BOX TYPE	A (mm)	B (mm) min-max	C (mm)	D (mm)	E (mm)	[dB(A)] (*)	BOX CODE
► RS 1000-1200/M C01	C8	1425	285 - 1000	110	1500	1800	10	3010401

(*) Average noise reduction according to EN 15036-1 standard

Gas train accessories

Adapters

In certain cases, an adapter must be fitted between the gas train and the burner, when the diameter of the gas train is different from the set diameter of the burner. Below are given the available adapters; please see on the Gas Train list the correct adapter codes to select.

ADAPTER	DIMENSIONS				ADAPTER CODE
	Ø1 DN	Ø2 DN	A mm	B mm	
	2"	65 / 80	780	230	20068058
	2"	65 / 80	230	375	20066253
	65	65 / 80	230	375	20066263
	80	65 / 80	230	375	20066268
	100	65 / 80	230	375	20066278
	125	65 / 80	245	375	20066284
	65	65	800	-	20065924
	80	80	800	-	20065937
	100	100	800	-	20065960
	125	125	800	-	20065968

Modulating Gas Burners

RS 1000÷1200/M C01 SERIES

Gas train accessories

Stabiliser spring



To vary the pressure range of the gas train stabilisers, accessory springs are available. The following table shows these accessories with their application range. Please refer to the technical manual for the correct choice of spring.

GAS TRAIN	SPRING COLOUR	SPRING PRESSURE RANGE mbar	SPRING CODE
► VGD/1 series	Neutral	0 - 22	20181839
	Yellow	15 - 120	20141900
	Red	100 - 250	20141901

Seal control kit



To test the valve seals on the gas train, a special "seal control kit" is available. The valve seal control device is compulsory (EN 676) on gas trains to burners with a maximum output over 1200 kW. The seal control is type VPS 504.

GAS TRAIN	KIT CODE for 50 Hz operation	KIT CODE for 60 Hz operation
► VGD 50/1	3010123+20186306	20050030+20186306
► VGD 65/1 - 80/1 - 100/1 - 125/1	3010123	20050030